


- THINLINE FRAME
- FOR USE IN STATIC SYSTEMS
- 3 HOUR RATING
- UL 555 CLASSIFIED
- VERTICAL MOUNT

MODELS:

- | | |
|-------------|-------------------|
| 0570 | TYPE A |
| 0580 | TYPE B |
| 0590 | TYPE CR/CO |
| 0590 | TYPE CSR |

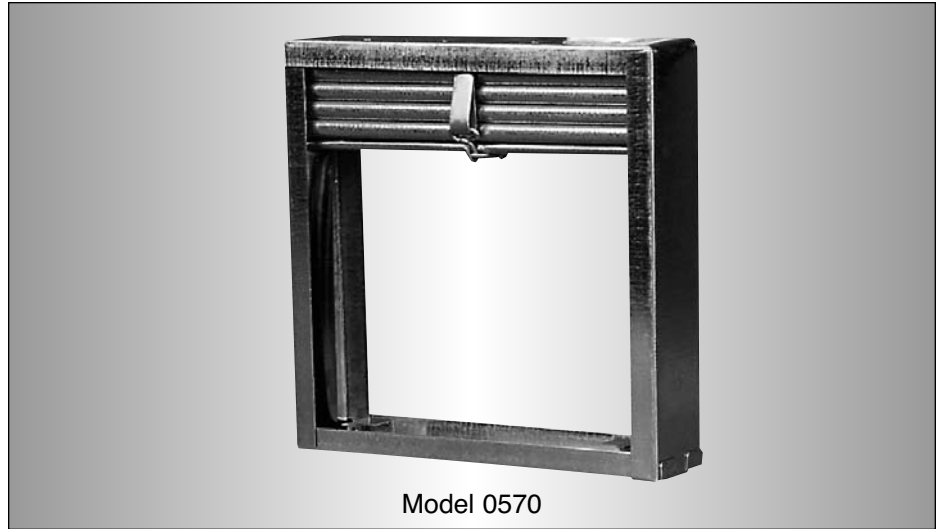


The Nailor 0500 Thinline Series, Models 0570, 0580, and 0590 curtain fire dampers are UL/ULC approved for use where building codes require the protection of HVAC ductwork penetrations in vertical fire separations (walls or partitions) that have a fire resistance rating of 4 hours or less. The 0500 Thinline Series is classified for use in static "fans off" systems where the HVAC system is automatically shut down in the event of a fire alarm. These thinline dampers are only 2" (51) deep making them ideal for installation in narrow fire rated partitions, transfer duct openings, behind grilles or any other application where room is limited. The 0500 Series feature corrosion resistant steel frame and blades for lasting performance, and a choice of transition styles and factory installed sleeves to suit duct size, making installation fast and simple.


D
CURTAIN FIRE DAMPERS

CONSTRUCTION DETAILS:

| | 0570 (Type A) | 0580 (Type B) | 0590 (Type CR/CO) | 0590 (Type CSR) |
|----------------------------------|---|---|---|---|
| FRAME: | 2" (51) wide, 22 ga. (0.85) roll-formed G60 galvanized steel | 2" (51) wide, 22 ga. (0.85) roll-formed G60 galvanized steel | 2" (51) wide, 22 ga. (0.85) roll-formed G60 galvanized steel; out of airstream | 2" (51) wide, 22 ga. (0.85) roll-formed G60 galvanized steel; out of airstream |
| BLADES: | Curtain type, interlocking blades, 22 ga. (0.85) roll-formed G60 galvanized steel | Out of airstream. Curtain type, interlocking blades, 22 ga. (0.85) roll-formed G60 galvanized steel | Out of airstream. Curtain type, interlocking blades, 22 ga. (0.85) roll-formed G60 galvanized steel | Out of airstream. Curtain type, interlocking blades, 22 ga. (0.85) roll-formed G60 galvanized steel |
| ENCLOSURE: | N/A | Type B 22 ga. (.085) galvanized steel | Type C Round or Oval 22 ga. (.085) galvanized steel | Type C Square or Rect. 22 ga. (.085) galvanized steel |
| FUSIBLE LINK: (UL Listed) | 165°F (74°C) Std. 212°F (100°C) available | 165°F (74°C) Std. 212°F (100°C) available | 165°F (74°C) Std. 212°F (100°C) available | 165°F (74°C) Std. 212°F (100°C) available |
| BLADE CLOSURE: | Gravity | Gravity | Gravity | Gravity |
| MOUNTING: | Vertical Only | Vertical Only | Vertical Only | Vertical Only |
| AVAILABLE SLEEVE: | Galvanized steel; Specify SL Option | Galvanized steel; Specify SL Option | Galvanized steel; Specify SL Option | Galvanized steel; Specify SL Option |

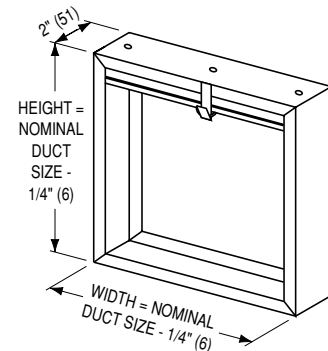


TYPE A: MODEL 0570

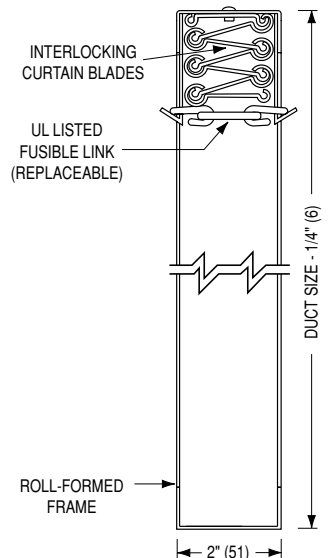


MODEL 0570V - VERTICAL MOUNT


For MIN./MAX. UL SIZES see chart on page D11.

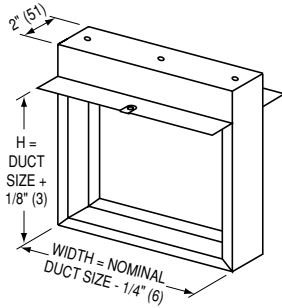


**TYPE B:
MODEL 0580**

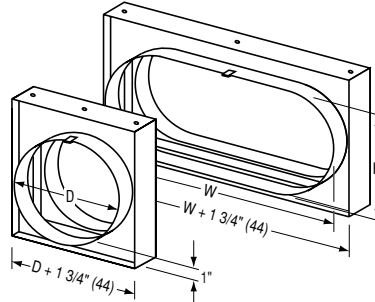

**TYPE CR:
MODEL 0590** **TYPE CO:
MODEL 0590**



**TYPE CSR
WITH COLLAR
(STANDARD):
MODEL 0590**



**TYPE CSR
WITHOUT COLLAR:
MODEL 0590**

For overall damper dimensions, see sizing chart on page D47.

PERFORMANCE DATA:

Curtain type fire dampers impose minimal resistance to air flow in the system. The following charts indicate both free area for the different damper types and static pressure losses for various velocities.

TYPE A THINLINE DAMPER FREE AREA – sq. ft.

| DUCT HEIGHT in inches (mm) | DUCT WIDTH in inches (mm) | | | | | | |
|----------------------------|---------------------------|----------|----------|----------|----------|----------|-----------|
| | 6 (152) | 12 (305) | 18 (457) | 24 (610) | 30 (762) | 36 (914) | 40 (1016) |
| 6 (152) | .12 | .27 | .44 | .59 | .75 | .94 | 1.02 |
| 12 (305) | .27 | .61 | .93 | 1.36 | 1.7 | 2.1 | 2.4 |
| 18 (457) | .42 | .94 | 1.5 | 2.2 | 2.7 | 3.4 | 3.7 |
| 24 (610) | .55 | 1.29 | 2.1 | 3.0 | 3.7 | 4.5 | 4.9 |
| 30 (762) | .71 | 1.65 | 2.6 | 3.8 | 4.3 | 5.7 | 6.3 |
| 36 (914) | .86 | 2.1 | 3.2 | 4.6 | 5.7 | 7.0 | 7.7 |
| 40 (1067) | .93 | 2.3 | 3.5 | 5.1 | 6.3 | 7.6 | 8.8 |
| 48 (1219) | 1.14 | 2.7 | 4.3 | 6.0 | 7.7 | 9.4 | |
| 54 (1372) | 1.32 | 3.1 | 4.9 | 6.9 | 8.8 | 10.7 | |
| 60 (1524) | 1.51 | 3.5 | 5.5 | 7.7 | 9.9 | 11.8 | |

TYPE B THINLINE DAMPER FREE AREA – sq. ft.

| DUCT HEIGHT in inches (mm) | DUCT WIDTH in inches (mm) | | | | | | |
|----------------------------|---------------------------|----------|----------|----------|----------|----------|-----------|
| | 6 (152) | 12 (305) | 18 (457) | 24 (610) | 30 (762) | 36 (914) | 40 (1016) |
| 6 (152) | .15 | .32 | .52 | .69 | .88 | 1.09 | 1.17 |
| 12 (305) | .31 | .70 | 1.07 | 1.55 | 1.95 | 2.4 | 2.7 |
| 18 (457) | .47 | 1.05 | 1.7 | 2.5 | 3.05 | 3.8 | 4.2 |
| 24 (610) | .62 | 1.44 | 2.3 | 3.4 | 4.2 | 5.1 | 5.6 |
| 30 (762) | .80 | 1.84 | 2.9 | 4.3 | 4.9 | 6.5 | 7.2 |
| 36 (914) | .95 | 2.33 | 3.6 | 5.1 | 6.4 | 7.8 | |
| 40 (1067) | 1.0 | 2.5 | 3.8 | 5.6 | 7.0 | 8.5 | |
| 48 (1219) | 1.3 | 3.1 | 4.8 | 6.8 | 8.6 | 10.4 | |

TYPE C DAMPERS HAVE FREE AREA EQUAL TO NOMINAL DUCT AREA.

To calculate Free Area of round duct:
DIAMETER² x .00545 = Free Area (sq ft.)

To determine pressure drop across open damper, calculate **free area velocity** as shown, find velocity on curve and read across for s.p. differential.

$$\text{Free Area Velocity (fpm)} = \frac{\text{cfm}}{\text{Free Area}}$$

Example:
1-36" x 36" Damper required for 14,000 cfm. (Type A)


$$\text{FAV} = \frac{14,000}{7 \text{ sq. ft.}} = 2000 \text{ fpm}$$

2000 fpm located on the 'A' curve shows a pressure drop of .12 in. wg.

cfm = cubic feet per minute
fpm = feet per minute velocity
S.P. = static pressure in inches water gauge
FAV = Free Area Velocity

Imperial System Shown
To convert to SI (metric) system:

Multiply cfm by .4719 for liters per second
fpm by .00508 for meters per second
in. wg. by .2486 for kilopascals
sq. ft. by .0929 for square meters

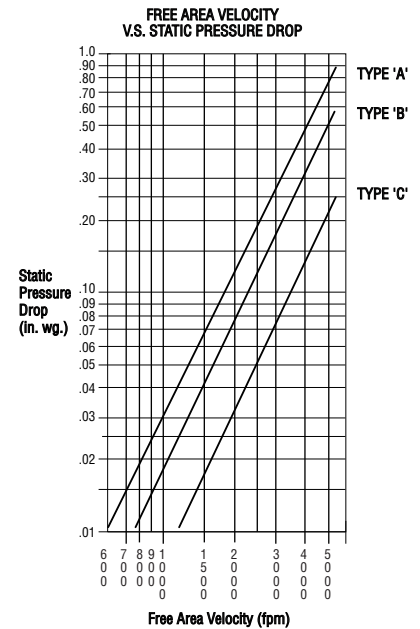

HOW TO SPECIFY

SUGGESTED SPECIFICATION:

Provide and install, as shown on plans and as described in specifications, 3 hour rated Thinline fire dampers as manufactured by Nailor Industries, meeting or exceeding the following criteria: Fire dampers shall be manufactured, tested and labeled in accordance with UL 555 Safety Standard for Fire Dampers - Sixth Edition, June 1999, and shall have a 3 hour fire resistance rating. Each fire damper shall bear a UL label verifying fire resistance rating in addition to intended mounting position. Fire dampers shall be suitably constructed for vertical or horizontal installation as required for each specific location.

Thinline style fire damper frame shall be a maximum of 2" (51) in width, roll-formed from G60 galvanized steel. Blades shall be Thinline type, roll-formed G60 galvanized steel. Each fire damper shall be complete with a (**specifier select one**) 165°F (74°C) or 212°F (100°C) UL Listed fusible link. Fire dampers shall each include a steel sleeve of appropriate length/gauge and retaining angles, supplied by damper manufacturer to ensure proper installation in accordance with damper manufacturer's instructions. Contractor shall provide and install an access door at locations where the fire damper cannot be accessed through grille or duct end opening, to allow for inspection, testing and fusible link replacement. Information submitted for approval shall include confirmation of UL qualifications, pressure drop data, and manufacturer's installation instructions. Each shipment of fire dampers shall include same installation instructions. 3 hour rated Thinline fire dampers shall be Nailor Industries Models 0570 (Type A), 0580 (Type B), 0590 (Type C).